



Pricing Zone 1	December	2021
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		2,186
Adhocs - Actual and Deemed		62
Monthly Tolerance Cap		196
Actual Maintenance Requirement		59
Actual System Losses - ARTC		25
Lesser Of Forecast/Actual Other Loss		69
Utilisation By Non-Coal Trains		316
Less Availability Exceptions	2	
Network Path Capability	3,503	
System Availability Surplus		592

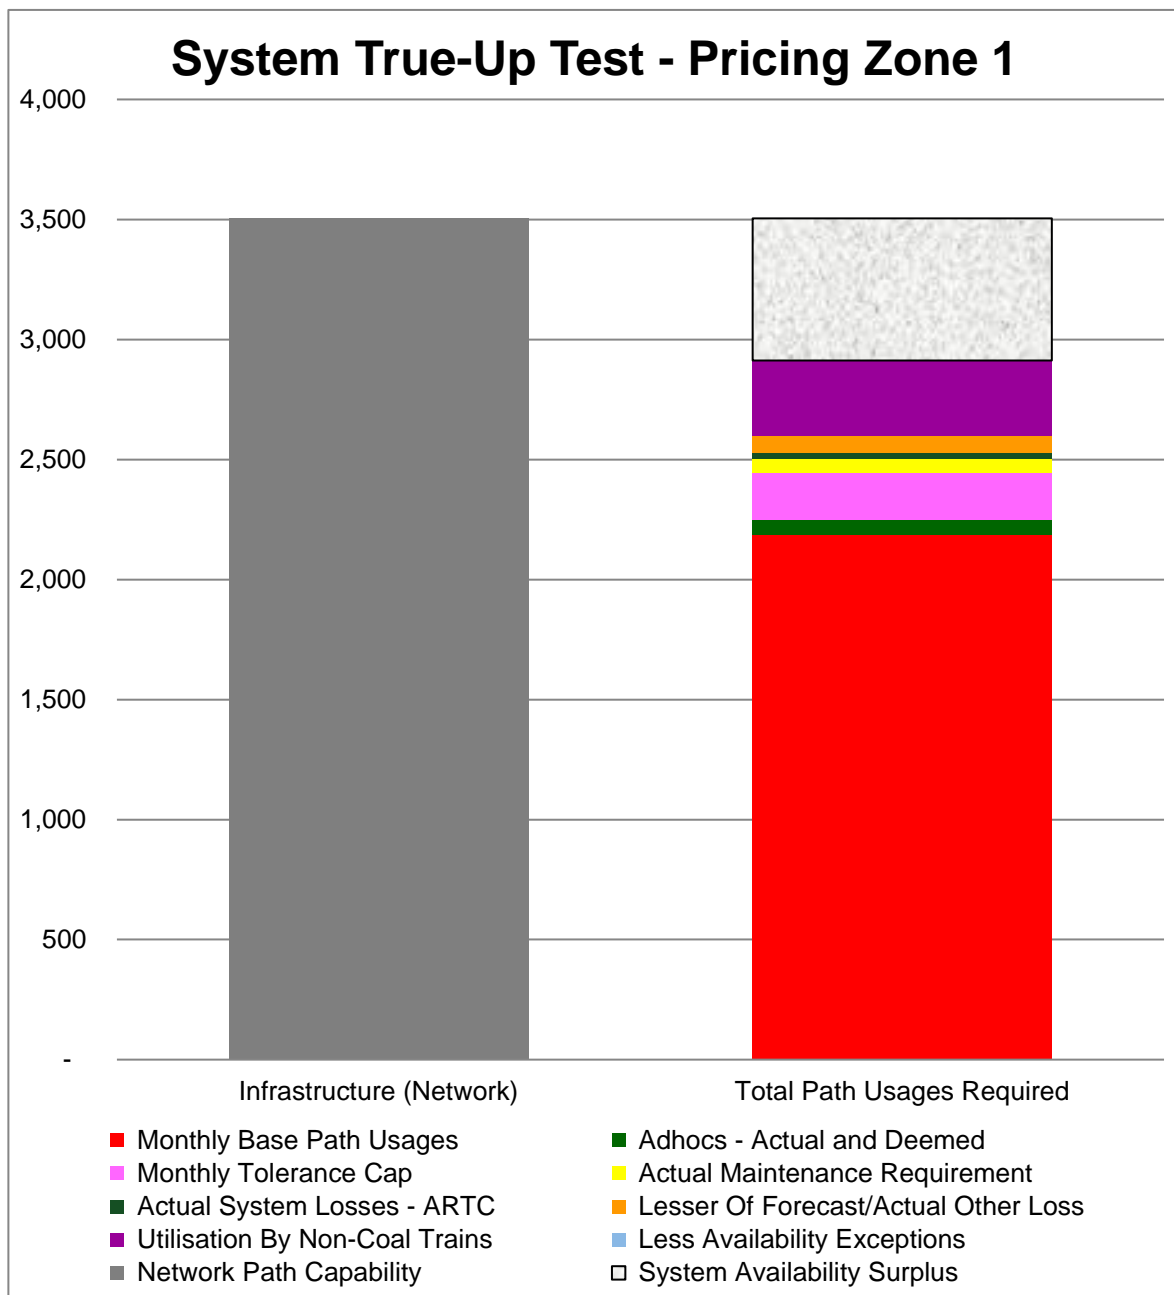

NB: ARTC confirms that Zone 1 had 2 access exemptions due to high voltage cable repair.


Pricing Zone 2	December	2021
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		600
Adhocs - Actual and Deemed		3
Monthly Tolerance Cap		54
Actual Maintenance Requirement		31
Actual System Losses - ARTC		65
Lesser Of Forecast/Actual Other Loss		40
Utilisation By Non-Coal Trains		18
Less Availability Exceptions	1	
Network Path Capability	868	
System Availability Surplus		59

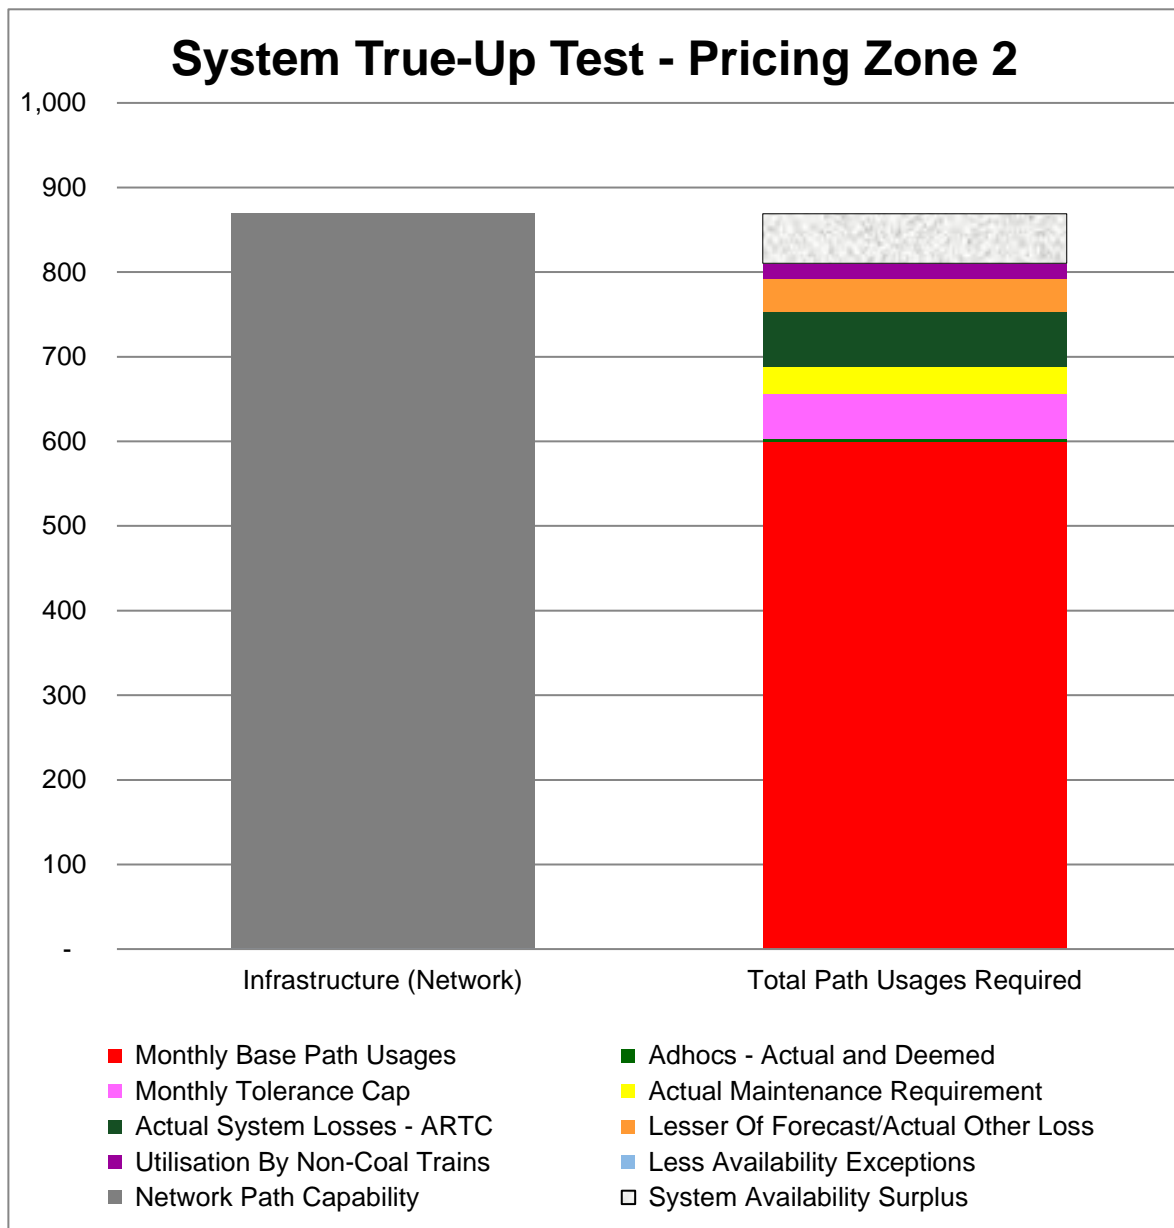

NB: ARTC confirms that Zone 2 had 1 access exemption due to high voltage cable repair.

ARTC considers publishing of system true-up test results for Pricing Zone 3 in aggregation will disclose confidential information about an individual Access Holder. In accordance with Clause 2.7(a) of Schedule 2 of Access Holder Agreements, ARTC is not publishing Pricing Zone 3. There is no System Availability Shortfall in Pricing Zone 3.

Pricing Zone 2	Quarter 4	2021
	Infrastructure (Network)	Total Path Usages Required
Quarterly Base Path Usages		-
Adhocs - Actual and Deemed		1,507
Quarterly Tolerance Cap		162
Actual Maintenance Requirement		231
Actual System Losses - ARTC		89
Lesser Of Forecast/Actual Other Loss		111
Utilisation By Non-Coal Trains		57
Less Availability Exceptions	44	
Network Path Capability	2,576	
System Availability Surplus		463

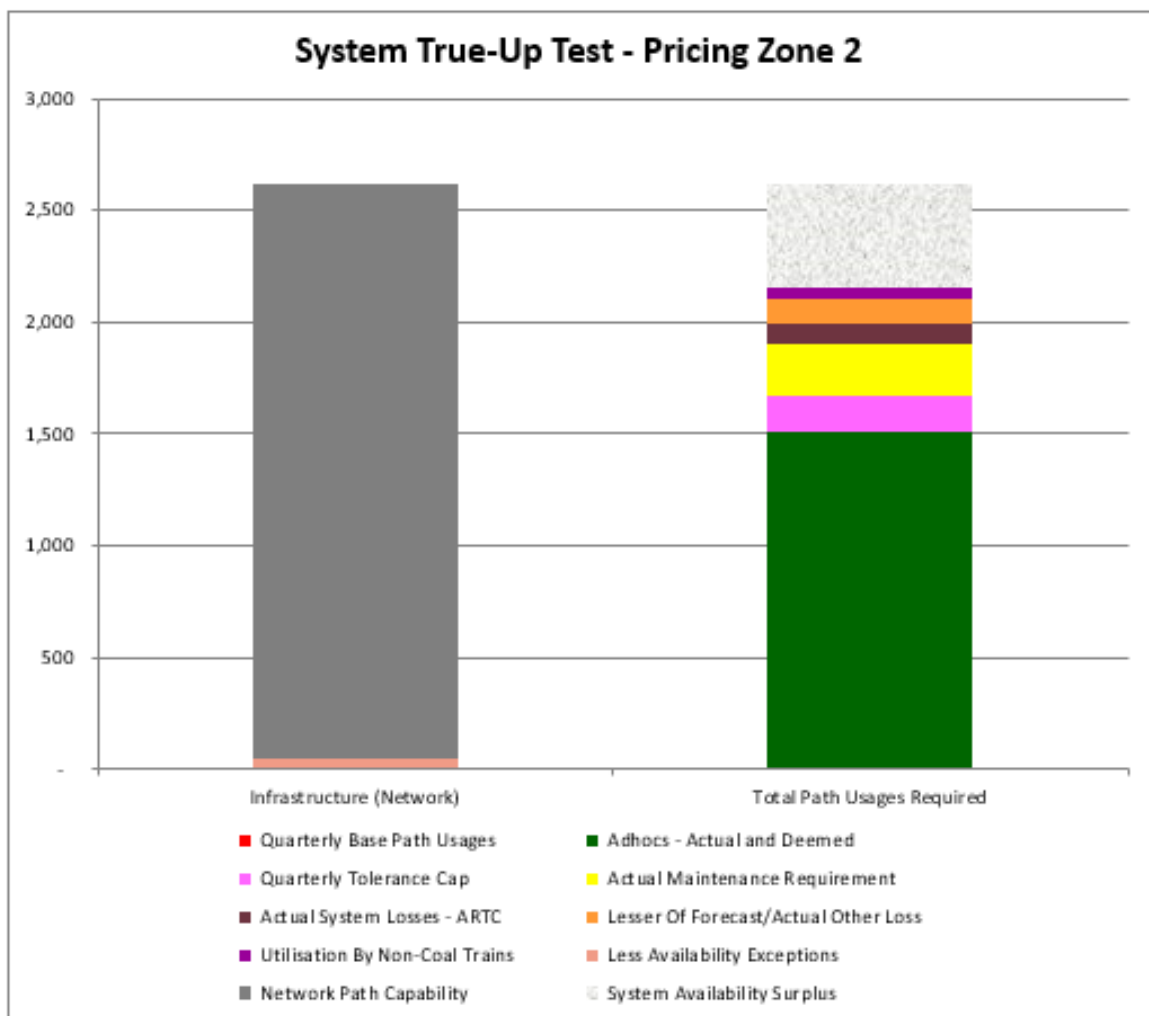

ARTC considers publishing of system true-up test results for Pricing Zone 1 and Pricing Zone 3 in aggregation will disclose confidential information about an individual Access Holder. In accordance with Clause 2.7(a) of Schedule 2 of Access Holder Agreements, ARTC is not publishing quarterly system true-up test results.

NB: There is no System Availability Shortfall in Pricing Zone 1 and 3.